

Evidence of Performance

Joint sound reduction of filling material

Test Report

no. 20-002317-PR01
(PB 01-K05-04-en-03)



Client **Soudal N.V.**
Everdongenlaan 18-20
2300 Turnhout
Belgium

Basis

EN ISO 10140-1: 2016
EN ISO 10140-2 : 2010
EN ISO 717-1 : 2013

Test report no. 20-002317-PR01 (PB 01-K05-04-de-03) dated 13/08/2020

Replaces Test report no. 20-002317-PR01 (PB 01-K05-04-en-02) dated 13/08/2020

Product	1-K polyurethane foam
Designation	Soudafoam FR HY
Density	21 g/l (10 mm width of joint), 24 g/l (20 mm width of joint), 20 g/l (30 mm width of joint)
Special features	-/-

Representation



Weighted joint sound reduction index $R_{S,w}$
Spectrum adaptation terms C and C_{tr}
width of joint 10 mm



$[R_{S,w}(C; C_{tr}) \geq 60 \text{ (-1; -4) dB}]$
width of joint 20 mm

$[R_{S,w}(C; C_{tr}) \geq 60 \text{ (-1; -4) dB}]$
width of joint 30 mm

$R_{S,w}(C; C_{tr}) = 57 \text{ (-10; -6) dB}$

Instructions for use

This procedure is suitable for the comparison of construction products designed for sealing (e.g. gaskets/seals, fillers for joints). The results can be used to evaluate the sound power ratio τ_e according to EN ISO 12354-3 Annex B. Using the calculated sound reduction of the joint for the calculation of the overall sound reduction is not a substitute for the sound reduction verification of the overall construction.

ift Rosenheim
13.08.2020

Validity

The data and results given relate solely to the tested and described specimen.

Testing the sound insulation does not allow any statement to be made on any further characteristics of the construction submitted regarding performance and quality.

Dr. Joachim Hessinger, Dipl.-Phys.
Head of Testing Department
Building Acoustics

Johann Baume, Dipl.-Ing. (FH)
Operating Testing Officer
Building Acoustics

Notes on publication

The ift Guidance Sheet "Conditions and Guidance for the Use of ift Test Documents" applies.

The cover sheet can be used as an abstract.

Contents

The test report contains a total of 11 pages:

- 1 Object
 - 2 Procedure
 - 3 Detailed results
 - 4 Instructions for use
- Data sheet (3 pages)

Joint sound reduction of filling material

Test Report 20-002317-PR01 (PB 01-K05-04-en-03) dated 13.08.2020

Client Soudal N.V., 2300 Turnhout (Belgium)

1 Object

1.1 Description of test specimen

Product	1-K polyurethane foam
Date of manufacturing of test specimen	20 th July 2020
Product designation	Soudafoam FR HY
Article No.	146752
Material	Polyurethane
Dimension	
Length of joint l	1,200 mm
Depth of joint d	100 mm
Width of joint w	10 mm, 20 mm and 30 mm
Joint cover	Without cover, cut foam on 30 th July 2020
Curing time	10 days
Density	21 g/l for 10 mm width of joint, 24 g/l for 20 mm width of joint, 20 g/l for 30 mm width of joint

The description is based on inspection of the test specimen at the **ift** Laboratory for Building Acoustics. Item designations / numbers as well as material specifications were provided by the client. Additional data provided by the manufacturer are marked with *.

1.2 Mounting to test rig

The sound reduction index R_s of the joint was measured in a mobile joint measuring apparatus as per EN ISO 10140-1:2016, Annex J, (see Figs. 1 and 2). This mobile measuring apparatus consists of a high-performance sound insulating element made of metal profiles and Bondal sheet with slide-in cassettes. The profiles of the slide-in cassettes are filled with sand. Using these cassettes, a great variety of joints with varying joint widths w can be created (Fig. 1).

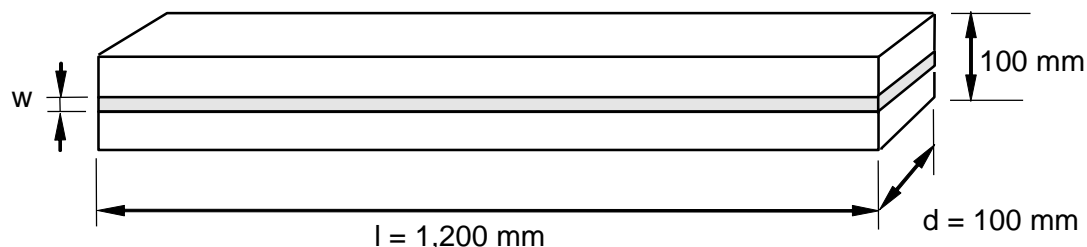


fig 1 Slide-in cassettes

Joint sound reduction of filling material

Test Report 20-002317-PR01 (PB 01-K05-04-en-03) dated 13.08.2020

Client Soudal N.V., 2300 Turnhout (Belgium)

These slide-in cassettes were filled 10 days before the test by employees of the **ift** with the filling material acc. to the guideline of the manufacturer. After curing the filling material was cut off and the cassettes were mounted to the high-performance sound insulating frame (Fig. 2). The frame was then mounted to the test opening in the separating wall of the window test rig (Z-wall) as per EN ISO 10 140-5. The test opening connecting joints were filled with foamed material and sealed on both sides with plastic sealant.

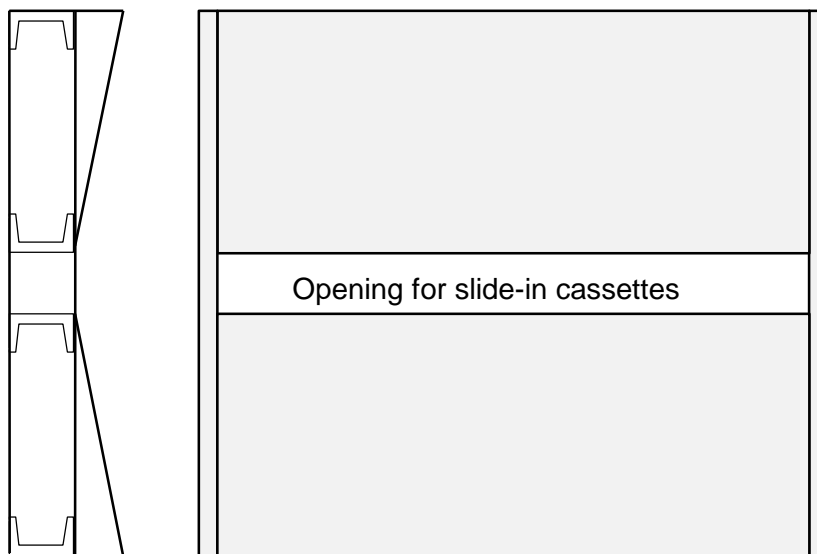


fig 2 Set-up of joint testing apparatus (high performance sound insulating element)



fig 3 Photo of the mounted element, taken by ift Laboratory for Building Acoustics



Joint sound reduction of filling material

Test Report 20-002317-PR01 (PB 01-K05-04-en-03) dated 13.08.2020

Client Soudal N.V., 2300 Turnhout (Belgium)

2 Procedure

2.1 Sampling

Sampling	The samples were selected by the client. The slide-in cassettes were filled by employees of the ift with the filler to be tested according to the instruction of the manufacturer.
Quantity	1
Manufacturer	Soudal N.V.
Manufacturing plant	Plant 2
Date of manufacture /	20 th July 2020
Date of sampling	
Batch number	212437921 10/20 17:42
Responsible person in charge	Mr. Jonas Daelemans
Delivery at ift	25 th June 2020 by delivery service.
ift registration number	50925/01

2.2 Process

Basis	
EN ISO 10140-1:2016	Acoustics; Laboratory measurement of sound insulation of building elements - Part 1: Application rules for specific products (ISO 10140-1: 2016); German version EN ISO 10140-1:2016
EN ISO 10140-2:2010	Acoustics; Laboratory measurement of sound insulation of building elements - Part 2: Measurement of airborne sound insulation (ISO 10140-2:2010)
EN ISO 717-1: 2013	Acoustics; Rating of sound insulation in buildings and of building elements - Part 1: Airborne sound insulation
Corresponds to the national German standard/s:	
	DIN EN ISO 10140-1:2016-12, DIN EN ISO 10140-2:2010-12 and DIN EN ISO 717-1 : 2013-06
Boundary conditions	As specified by the standard.
Deviation	There are no deviations from the test method/s and/or test conditions.
Test noise	Pink noise
Measuring filter	One-third-octave band filter
Measurement limits	
Low frequencies	The test rooms full fill the recommended size for testing in the frequency range from 50 Hz to 80 Hz as per EN ISO 10140-4:2010 Annex A (informative). A moving loudspeaker was used.
Background noise level	The background noise level in the receiving room was determined during measurement and the receiving room level

Joint sound reduction of filling material

Test Report 20-002317-PR01 (PB 01-K05-04-en-03) dated 13.08.2020

Client Soudal N.V., 2300 Turnhout (Belgium)

	L_2 corrected by calculation as per EN ISO 10140-4: 2010 Clause 4.3.
Maximum insulation	The maximum insulation of the test rig is partly within the range of the test results. Therefore the tested values are minimum values. A correction by calculation was performed for maximum sound insulation.
Measurement of reverberation time	Arithmetical mean: two measurements each of 2 loudspeaker and 3 microphone positions (a total of 12 independent measurements).
Measurement equation A	$A = 0,16 \cdot \frac{V}{T} \text{ m}^2$
Measurement of sound level difference	Minimum of 2 loudspeaker positions and rotating microphones.
Measurement equation	$R_s = L_1 - L_2 + 10 \log \frac{S_N \cdot l}{A \cdot l_N} \text{ dB}$

KEY

R_s	Joint sound reduction index in dB
L_1	Sound pressure level source room in dB
L_2	Sound pressure level receiving room in dB
l	Length of joint in m
S_N	Reference area (1 m ²)
l_N	Reference length (1 m)
A	Equivalent absorption area in m ²
V	Volume of receiving room in m ³
T	Reverberation time in s

2.3 Test apparatus

Device	Type	Manufacturer
Integrating sound meter	Type Nortronic 840	Norsonic-Tippkemper
Microphone preamplifiers	Type 1201	Norsonic-Tippkemper
Microphone unit	Type 1220	Norsonic-Tippkemper
Calibrator	Type 1251	Norsonic-Tippkemper
Dodecahedron loudspeakers	Type 229	Norsonic-Tippkemper
Amplifier	Type 235	Norsonic-Tippkemper
Rotating microphone boom	Type 265	Norsonic-Tippkemper

The ift Laboratory for Building Acoustics participates in comparative measurements at the Physikalisch-Technische Bundesanstalt (PTB) in Braunschweig every three years. The last one was in April 2019. The sound level meter used, Series No. 24842, was DKD calibrated by the company Norsonic Tippkemper (DKD - Deutscher Kalibrierdienst "German Calibration Service") on 05th February 2019.

Joint sound reduction of filling material

Test Report 20-002317-PR01 (PB 01-K05-04-en-03) dated 13.08.2020

Client Soudal N.V., 2300 Turnhout (Belgium)

**2.4 Testing**Date 30th July 2020

Operating Testing Officer Johann Baume

3 Detailed results

The values of the measured sound reduction index R_S of the joint for the tested filler are plotted against frequency in the data sheets (Annex). Based on EN ISO 717 - 1, this is used to calculate the weighted sound reduction index $R_{S,w}$ of the joint and the spectrum adaptation terms C and C_{tr} , related to joint length $l = 1.20$ m, for the frequency range 100 Hz to 3,150 Hz.

The diagram includes the maximum sound reduction of the test set-up (related to $l = 1.20$ m), plotted with a maximum weighted sound reduction index $R_{S,w \max}(C; C_{tr}) = 60 (-1; -4)$ dB.

The resulting sound reduction indices for joints are within the range for maximum sound insulation; in these cases the values obtained are minimum values. For maximum insulation, it has been corrected by calculation as per EN ISO 10140-1:2016, Annex J. Table 1 lists the weighted sound reduction indices of the different joint designs.

Table 1 Test results, joint depth $d = 100$ mm

Weighted joint sound reduction index $R_{S,w}(C; C_{tr})$ in dB	Measures taken, comments
$\geq 60 (-1; -4)$	Width of joint 10 mm, filled with Soudafoam FR HY
$\geq 60 (-1; -4)$	Width of joint 20 mm, filled with Soudafoam FR HY
57 (-10; -6)	Width of joint 30 mm, filled with Soudafoam FR HY
60 (-1; -4)	Maximum sound insulation

4 Instructions for use**4.1 Application for DIN 4109: 2018**

Basis

DIN 4109-1: 2018-01

Sound insulation in buildings - Part 1: Minimum requirements

DIN 4109-2: 2018-01

Sound insulation in buildings - Part 2: Verification of compliance with the requirements by calculation

Joint sound reduction of filling material

Test Report 20-002317-PR01 (PB 01-K05-04-en-03) dated 13.08.2020

Client Soudal N.V., 2300 Turnhout (Belgium)

The weighted joint sound reduction index determined in accordance with Section 3, can be directly used for verification of sound insulation by calculation in accordance with DIN 4109-2.

This sound reduction index of joints is comparable to the linear sound reduction index of a building component with 1 m joint length for each m² area and where the sound is transmitted only through the joint.

If the joint is combined with a building component (e.g. window with area S and weighted sound reduction index R) and assuming the building component's area S₁ >> than the area of the joint (w · l, w = joint width), for the associated joint length l and a reference length l₀ = 1 m the resulting sound reduction index R_{i,w} of the i-th-window with installation joint is calculated as follows:

$$R_{i,w} = -10 \cdot \log \left(10^{\frac{-R_w}{10}} + \frac{l \cdot l_0}{S} \cdot 10^{\frac{-R_{s,w}}{10}} \right) \text{dB}$$

For calculation of the total weighted apparent sound reduction index R'_{w,ges} in accordance with DIN 4109-2 Clause 4, the input data obtained from laboratory measurements must be stated in 1/10 dB. For the implementation of sound transmission via installation joint the resulting weighted joint sound reduction index can then be applied directly to the joint sound insulation. This gives:

$$R_{S,w} \geq 60.6 \text{ dB (width of joint 10 mm)}$$

$$R_{S,w} \geq 60.2 \text{ dB (width of joint 20 mm)}$$

$$R_{S,w} = 57.2 \text{ dB (width of joint 30 mm)}$$

4.2 Uncertainty of measurement, single number ratings in 1/10 dB

Basis

EN ISO 12999-1: 2014 Acoustics; Determination and application of measurement uncertainties in building acoustics, part 1: sound insulation (ISO 12999-1: 2014)

The resulting weighted sound reduction index of joints (in 1/10 dB with measurement uncertainty), determined on the basis of EN ISO 717-1:2013-06 is:

$$R_{S,w} = 60.6 \text{ dB} \pm 1.2 \text{ dB (width of joint 10 mm)}$$

$$R_{S,w} = 60.2 \text{ dB} \pm 1.2 \text{ dB (width of joint 20 mm)}$$

$$R_{S,w} = 57.2 \text{ dB} \pm 1.2 \text{ dB (width of joint 30 mm)}$$

The specified measurement uncertainty is the average standard deviation of laboratory measurements (standard measurement uncertainty σ_R for measurement situation A: Characterisation of a building component by laboratory measurements as per EN ISO 12999-1:2014, Table 3 $\sigma_R = 1.2$ dB).

Joint sound reduction of filling material

Test Report 20-002317-PR01 (PB 01-K05-04-en-03) dated 13.08.2020

Client Soudal N.V., 2300 Turnhout (Belgium)

The product declaration must use the integral value of the joint sound reduction index and the spectrum adaptation terms as given in Section 3.

4.3 General remarks:

The method is suitable for comparing construction products designed for sealing purposes (e.g. seals/gaskets, fillers to seal joints). The results can be used to evaluate the sound power ratio τ_e as per EN ISO 12354-3 Annex B. Using the calculated sound reduction of the joint for the calculation of the overall sound reduction is not a substitute for the verification of the overall construction

In practice, e.g. when combining the sound insulation of a window with that of a joint in an existing opening, the following must be taken into account:

- a) for physical reasons, the sound reduction index of joints must be corrected by approx. -3 dB in the area of corners and edges;
- b) the existing thickness of the window frame profile (joint depth d) must be adapted with a correction between -1 dB and -2 dB.
- c) experience shows that the filling of window niches in edges and difficult reachable areas are weak points by handling

From these results, that in practice the measured sound reduction index of joint has to be

- a) either corrected by -4 dB or
- b) increased by additional sealing with backfilling tape with or without bar or elastic sealant with filling band.

Remark on transfer of the test results

According to the experience of **ift** the following correction reduction has to be applied for a window with an area of 1.82 m^2 and a surrounding joint length of 5.5 m (conditions in laboratory) with the sound reduction index of a window of $R_w \geq 40 \text{ dB}$:

$$R_{w,\text{res}} = R_{w,\text{Fe}} - 2 \text{ dB}$$

The corrective factor of -2 dB is inapplicable if a sealing is carried out on both sides additionally to the foaming. For windows with $R_w \geq 48 \text{ dB}$ higher reductions may apply.

Joint sound reduction index according to ISO 10140-1

Determination of sound reduction index of joints

Client: Soudal N.V., 2300 Turnhout (Belgium)

Product designation Soudafoam FR HY



Design of test specimen

1-K polyurethane foam

Joint size


Length l 1,200 mm

Depth d 100 mm

width w 10 mm

Density 21 g/l

Drawing of the test arrangement

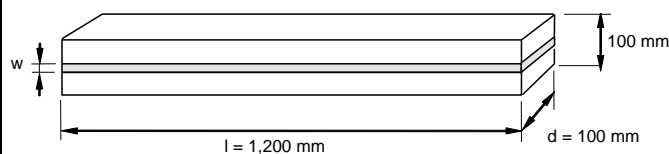

Test date 30th July 2020

Test length l 1.2 m

Test rig as per EN ISO 10140-5

Partition wall Double-leaf concrete wall

Test noise pink noise

Volumes of test rooms $V_S = 109.9 \text{ m}^3$
 $V_R = 101.3 \text{ m}^3$

Maximum joint sound reduction index
 $R_{S,w,max} = 60 \text{ dB}$ (related to test length)

Mounting conditions


Mounting of the cassette in high performance sound insulating element.

Climate in test rooms 23°C / 65 % RH

Static air pressure 968 hPa

f in Hz	R_S in dB
50	$\geq 37.5^*$
63	$\geq 42.8^*$
80	$\geq 45.6^*$
100	$\geq 45.3^*$
125	$\geq 45.8^*$
160	$\geq 49.2^*$
200	$\geq 49.2^*$
250	$\geq 50.7^*$
315	$\geq 53.5^*$
400	$\geq 56.3^*$
500	$\geq 58.7^*$
630	$\geq 59.2^*$
800	$\geq 60.3^*$
1,000	$\geq 60.3^*$
1,250	$\geq 58.4^*$
1,600	$\geq 60.2^*$
2,000	$\geq 64.3^*$
2,500	$\geq 65.7^*$
3,150	$\geq 64.7^*$
4,000	$\geq 64.2^*$
5,000	$\geq 60.5^*$

(* = minimum value)

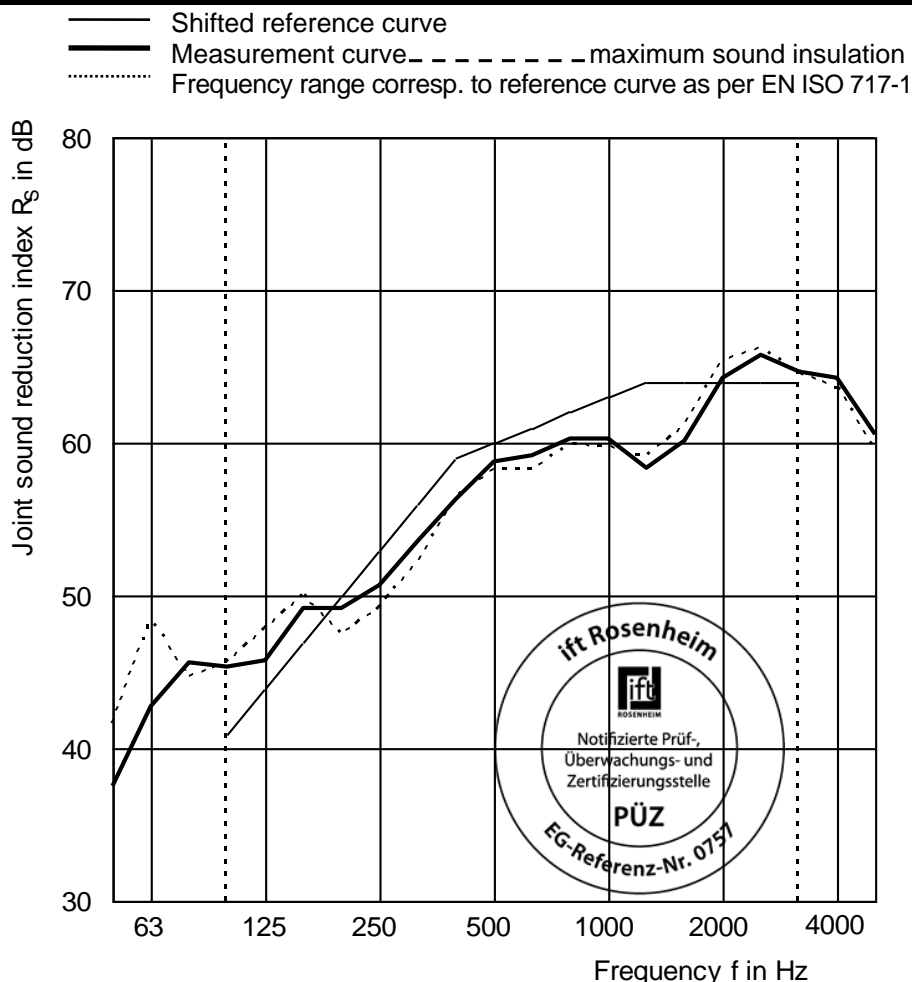

Rating according to EN ISO 717-1 (in third octave bands):

$[R_{S,w} (C; C_{tr}) \geq 60 (-1; -4) \text{ dB}]$ $C_{50-3,150} = -1 \text{ dB}; C_{100-5,000} = -1 \text{ dB}; C_{50-5,000} = -1 \text{ dB}$
 $C_{tr,50-3,150} = -5 \text{ dB}; C_{tr,100-5,000} = -4 \text{ dB}; C_{tr,50-5,000} = -5 \text{ dB}$

Test report no.: 20-002317-PR01 (PB 01-K05-04-en-03)

Page 9 of 11, Data sheet 01

ift Rosenheim

Laboratory for Building Acoustics

H. Baume
Dipl. Ing. (FH) Johann Baume
Operating Testing Officer

Joint sound reduction index according to ISO 10140-1

Determination of sound reduction index of joints

Client: Soudal N.V., 2300 Turnhout (Belgium)

Product designation Soudafoam FR HY



Design of test specimen

1-K polyurethane foam

Joint size

Length l 1,200 mm

Depth d 100 mm

width w 20 mm

Density 24 g/l

Test date 30th July 2020

Test length l 1.2 m

Test rig as per EN ISO 10140-5

Partition wall Double-leaf concrete wall

Test noise pink noise

Volumes of test rooms $V_S = 109.9 \text{ m}^3$
 $V_R = 101.3 \text{ m}^3$


Maximum joint sound reduction index
 $R_{S,w,max} = 60 \text{ dB}$ (related to test length)

Mounting conditions
Mounting of the cassette in high performance sound insulating element.

Climate in test rooms 23°C / 65 % RH

Static air pressure 968 hPa


Drawing of the test arrangement

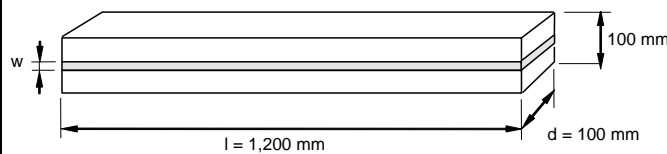

f in Hz	R_S in dB
50	$\geq 44.5^*$
63	$\geq 50.2^*$
80	$\geq 49.1^*$
100	$\geq 45.6^*$
125	$\geq 47.0^*$
160	$\geq 49.3^*$
200	$\geq 48.6^*$
250	$\geq 50.8^*$
315	$\geq 53.9^*$
400	$\geq 56.7^*$
500	$\geq 57.7^*$
630	$\geq 58.9^*$
800	$\geq 60.9^*$
1,000	$\geq 59.7^*$
1,250	$\geq 58.1^*$
1,600	$\geq 59.3^*$
2,000	$\geq 63.1^*$
2,500	$\geq 64.2^*$
3,150	$\geq 63.7^*$
4,000	$\geq 60.2^*$
5,000	47.0

(* = minimum value)

— Shifted reference curve
— Measurement curve
- - - - - maximum sound insulation
..... Frequency range corresp. to reference curve as per EN ISO 717-1

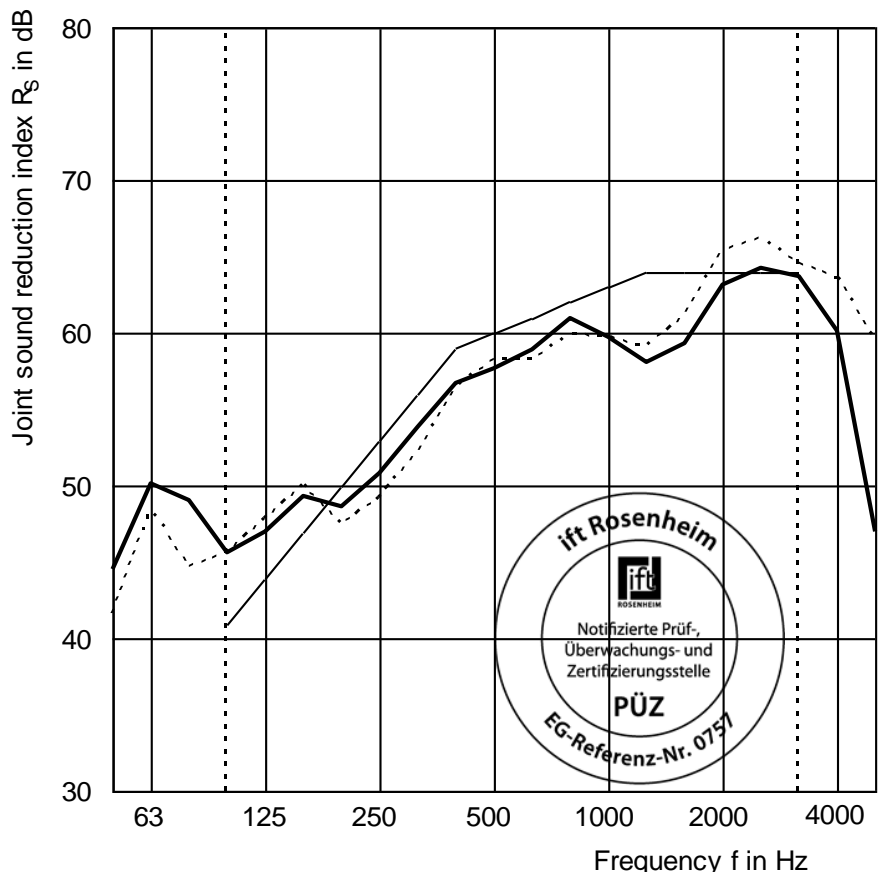

Rating according to EN ISO 717-1 (in third octave bands):

$[R_{S,w} (C; C_{tr}) \geq 60 (-1; -4) \text{ dB}]$ $C_{50-3,150} = -1 \text{ dB}$; $C_{100-5,000} = -5 \text{ dB}$; $C_{50-5,000} = -5 \text{ dB}$
 $C_{tr,50-3,150} = -4 \text{ dB}$; $C_{tr,100-5,000} = -4 \text{ dB}$; $C_{tr,50-5,000} = -5 \text{ dB}$

Test report no.: 20-002317-PR01 (PB 01-K05-04-en-03)

Page 10 of 11, Data sheet 02

ift Rosenheim

Laboratory for Building Acoustics

J. Baume
Dipl. Ing. (FH) Johann Baume
Operating Testing Officer

Joint sound reduction index according to ISO 10140-1

Determination of sound reduction index of joints

Client: Soudal N.V., 2300 Turnhout (Belgium)

Product designation Soudafoam FR HY



Design of test specimen

1-K polyurethane foam

Joint size

Length l 1,200 mm

Depth d 100 mm

width w 30 mm

Density 20 g/l

Test date 30th July 2020

Test length l 1.2 m

Test rig as per EN ISO 10140-5

Partition wall Double-leaf concrete wall

Test noise pink noise

Volumes of test rooms $V_S = 109.9 \text{ m}^3$
 $V_R = 101.3 \text{ m}^3$


Maximum joint sound reduction index
 $R_{S,w,max} = 60 \text{ dB}$ (related to test length)

Mounting conditions
Mounting of the cassette in high performance sound insulating element.

Climate in test rooms 23°C / 65 % RH

Static air pressure 968 hPa


Drawing of the test arrangement

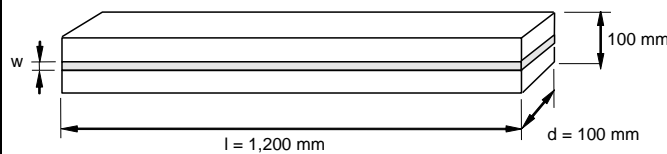

f in Hz	R_S in dB
50	$\geq 28.9^*$
63	$\geq 38.9^*$
80	$\geq 40.9^*$
100	$\geq 43.2^*$
125	$\geq 46.7^*$
160	$\geq 49.3^*$
200	$\geq 49.4^*$
250	$\geq 50.4^*$
315	$\geq 53.6^*$
400	$\geq 56.3^*$
500	$\geq 57.1^*$
630	$\geq 58.7^*$
800	$\geq 59.9^*$
1,000	$\geq 59.4^*$
1,250	$\geq 58.0^*$
1,600	$\geq 59.2^*$
2,000	$\geq 62.1^*$
2,500	58.6
3,150	38.3
4,000	31.7
5,000	35.6

(* = minimum value)

— Shifted reference curve
— Measurement curve
- - - - - maximum sound insulation
..... Frequency range corresp. to reference curve as per EN ISO 717-1

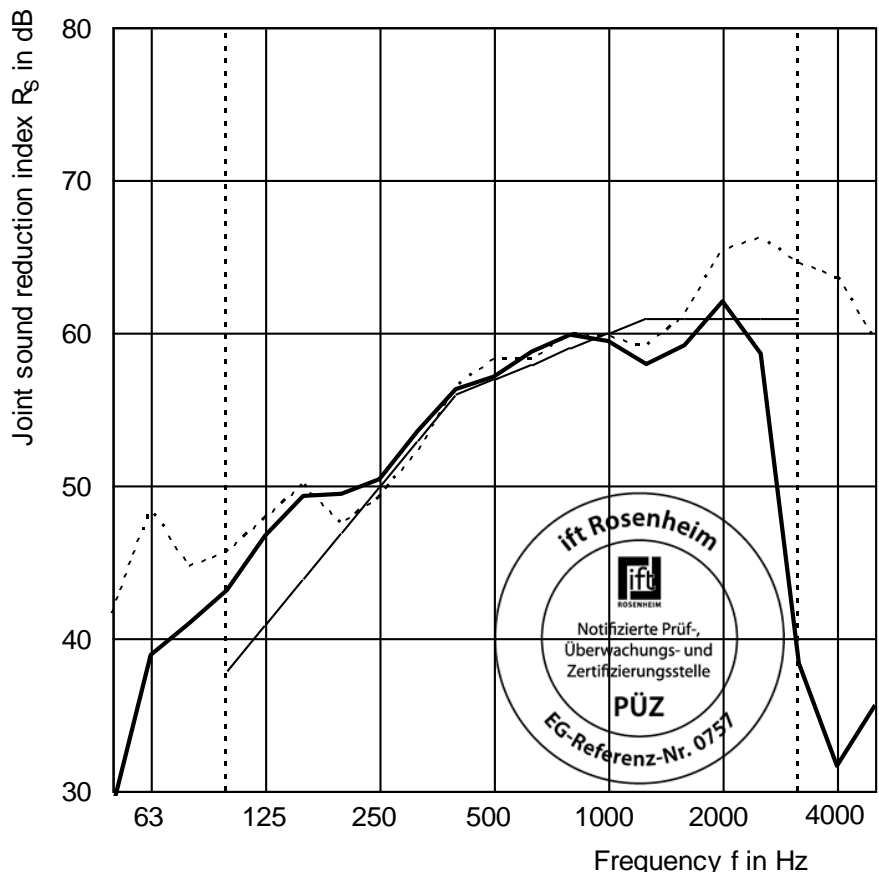

Rating according to EN ISO 717-1 (in third octave bands):

$R_{S,w} (C; C_{tr}) = 57 (-10; -6) \text{ dB}$ $C_{50-3,150} = -10 \text{ dB}$; $C_{100-5,000} = -17 \text{ dB}$; $C_{50-5,000} = -17 \text{ dB}$
 $C_{tr,50-3,150} = -8 \text{ dB}$; $C_{tr,100-5,000} = -12 \text{ dB}$; $C_{tr,50-5,000} = -12 \text{ dB}$

Test report no.: 20-002317-PR01 (PB 01-K05-04-en-03)

Page 11 of 11, Data sheet 03

ift Rosenheim

Laboratory for Building Acoustics

H. Baume
Dipl. Ing. (FH) Johann Baume
Operating Testing Officer